


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----

Obsah: **R4.1**

Akce: Domov pro seniory Havlíčkův Brod

D.1.4.7. SILNOPROUDÁ ELEKTROTECHNIKA
VČETNĚ OCHRANY PŘED BLESKEM

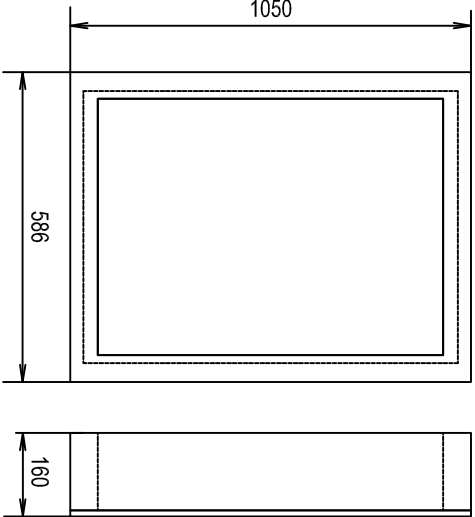

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
Vypracoval:	Marek Fischer									Investor:	Domov pro seniory Havlíčkův Brod				Zak. číslo:	TO-472	A.K.:		Listů: 5
Kontroloval:	Ing. Martin Ulčňý														Změna/Datum:		V.č.:		List: 1
Datum :	10/2016														Měřitko:	N	D.1.4.7.b.21.		

L1,L2,L3 - 400/230V In 40A 50Hz, Ik <10kA

Q1
40A

F
50kA tř II C
L1,L2,L3,N+PE

F1
B25A

F2
B20A

FA3
B16 0.03 AC

FA4
B16 0.03 AC

FA5
B16 0.03 AC

FA6
B16 0.03 AC

CHKE-R25 HOP
CHKE-R 4 KOUP.
CHKE-R 4 KOUP

WL4
CHKE-R
RH
35kV
-

rezerva

rezerva

WL3.4.1
CHKE-R 3x2.5
zásuvky
4.15
-

WL4.4.1
CHKE-R 3x2.5
zásuvky
4.13
-

WL5.4.1
CHKE-R 3x2.5
zásuvky
4.11
-

WL6.4.1
CHKE-R 3x2.5
zásuvky
4.09
-


N

PE


PEN

OP

L1,L2,L3 - 400/230V In 40A 50Hz Ik < 10kA

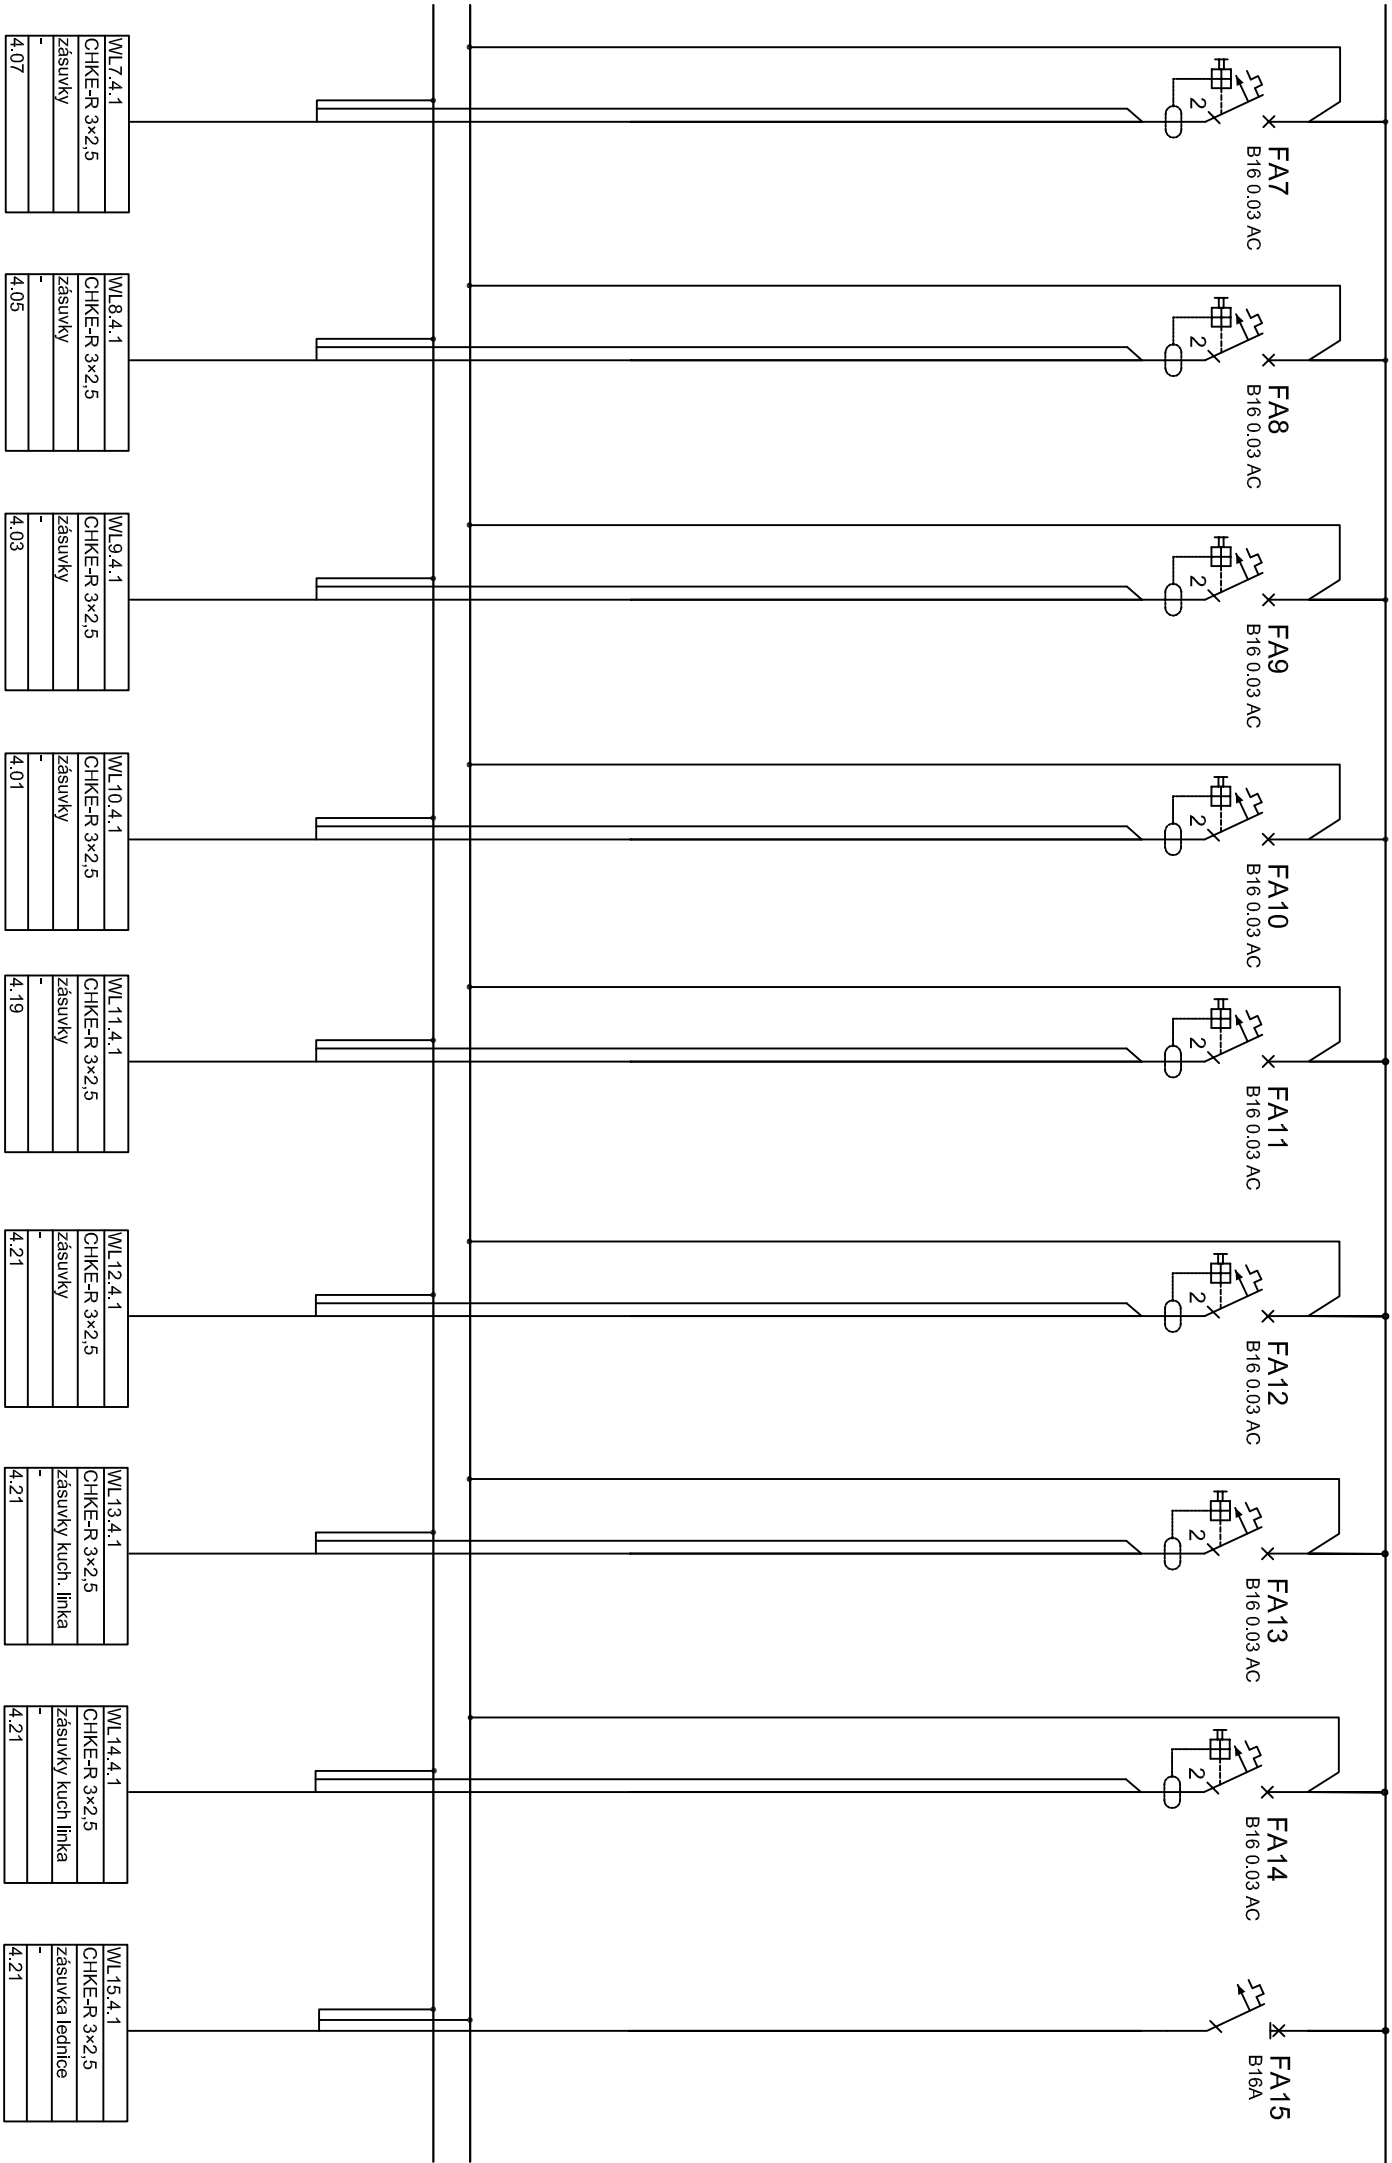

L1,L2,L3 - 400/230V In 40A 50Hz Ik < 10kA

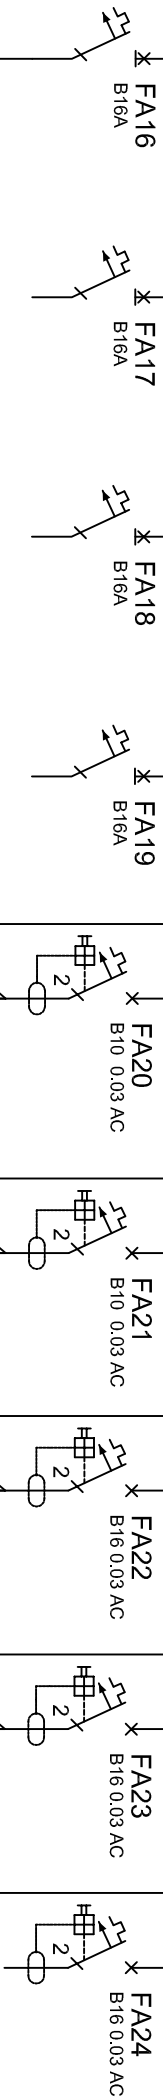

WL16.4.1
CHKE-R 3x2.5
zásuvka var.deska
-
4.21

rezerva
-

rezerva
-

rezerva
-

WL20.4.1
CHKE-R 3x1.5
světlo
-
4.15, 4.13



WL21.4.1
CHKE-R 3x1.5
světlo
-
4.11, 4.09, 4.07

WL22.4.1
CHKE-R 3x1.5
světlo
-
4.05, 4.03

WL23.4.1
CHKE-R 3x1.5
světlo
-
4.01, 4.19, 4.21

rezerva
-

L1,L2,L3 - 400/230V In 40A 50Hz Ik < 10kA

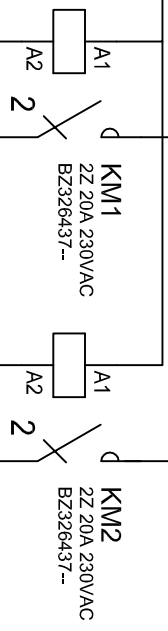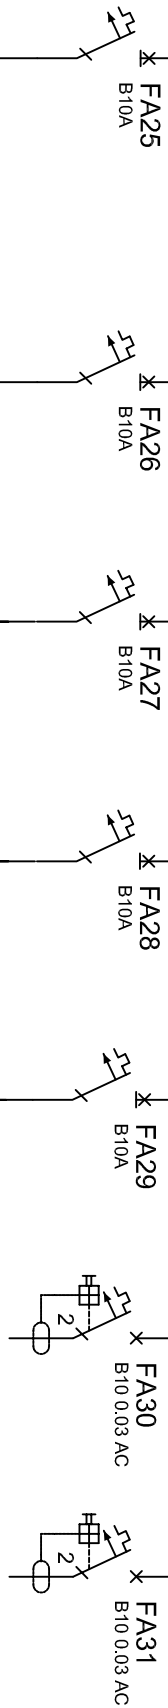

WL25.4.1a
CHKE-R 3x1.5
vypínače v recepcii
-

WL25.4.1
CHKE-R 3x1.5
světlo chodba
-
4.21

WL25.4.1
CHKE-R 3x1.5
světlo chodba
-
4.21

WL27.4.1
CHKE-R 3x1.5
žaluzie, vpust
1 kW
venek

WL26.4.1
CHKE-R 3x1.5
žaluzie
0.2 kW
venek

WL28.4.1
CHKE-R 3x1.5
nouzové světlo
0.8 kW
-

CHKE-R 3x1.5
rezerva
-

CHKE-R 3x1.5
rezerva
-