


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----

Obsah: **R2.2**

Akce: Domov pro seniory Havlíčkův Brod

D.1.4.7. SILNOPROUDÁ ELEKTROTECHNIKA
VČETNĚ OCHRANY PŘED BLESKEM

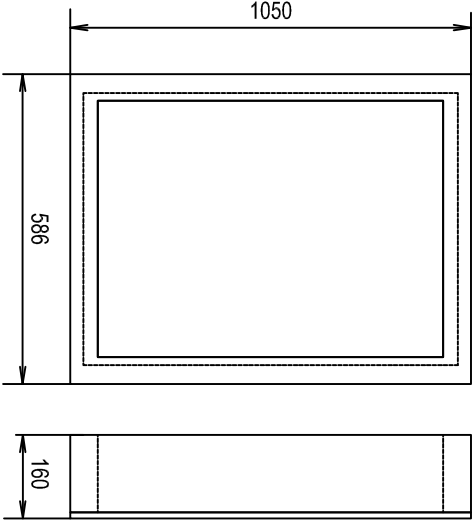

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
Vypracoval:	Marek Fischer									Investor:				Zak. číslo:	TO-472	A.K.:		Listů:	5
Kontroloval:	Ing. Martin Ulčný													Změna/Datum:		V.č.:			
Datum :	10/2016									Domov pro seniory Havlíčkův Brod				Měřtko:	N		D.1.4.7.b.16.	List:	1

L1,L2,L3 - 400/230V In 40A 50Hz, Ik <10kA

Q1
40A

F
50kA tř II C
L1,L2,L3,N+PE

F1
B25A

F2
B20A

FA3
B16 0.03 AC

FA4
B16 0.03 AC

FA5
B16 0.03 AC

FA6
B16 0.03 AC

CHKE-R25 HOP
CHKE-R 4 KOUP.
CHKE-R 4 KOUP

WL5
CHKE-R
RH
35kV
-

rezerva

rezerva

WL3.2.2
CHKE-R 3x2.5
zásuvky
-
2.31

WL4.2.2
CHKE-R 3x2.5
zásuvky
-
2.33

WL5.2.2
CHKE-R 3x2.5
zásuvky
-
2.35

WL6.2.2
CHKE-R 3x2.5
zásuvky
-
2.37


N

PE


PEN

OP



L1,L2,L3 - 400/230V In 40A 50Hz Ik < 10kA

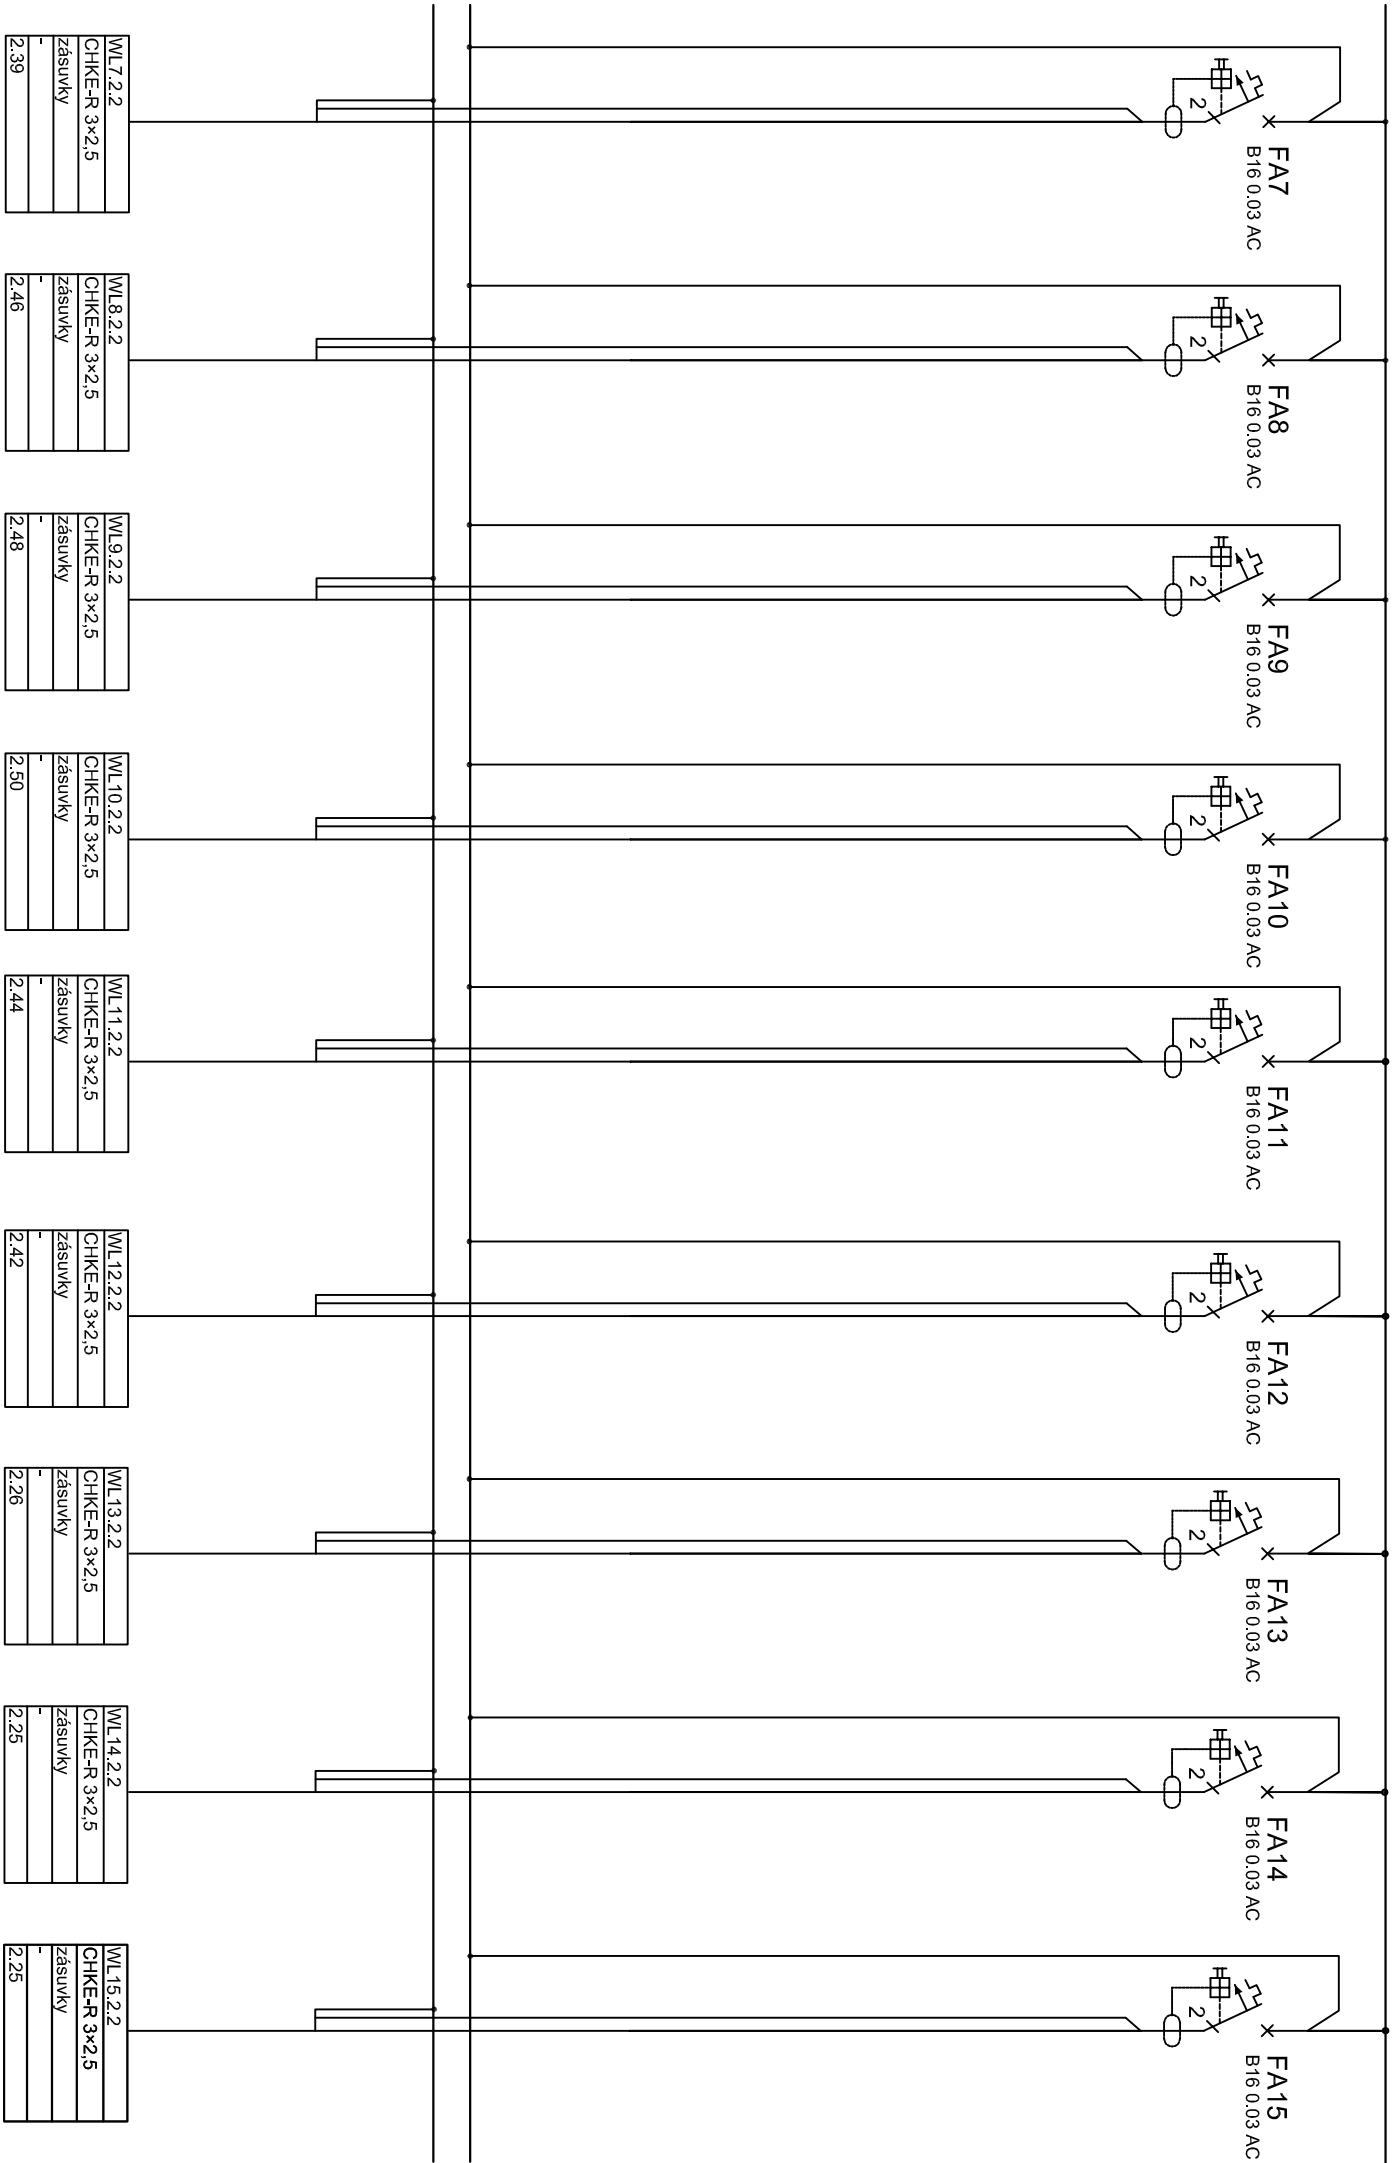

L1,L2,L3 - 400/230V In 40A 50Hz Ik < 10kA

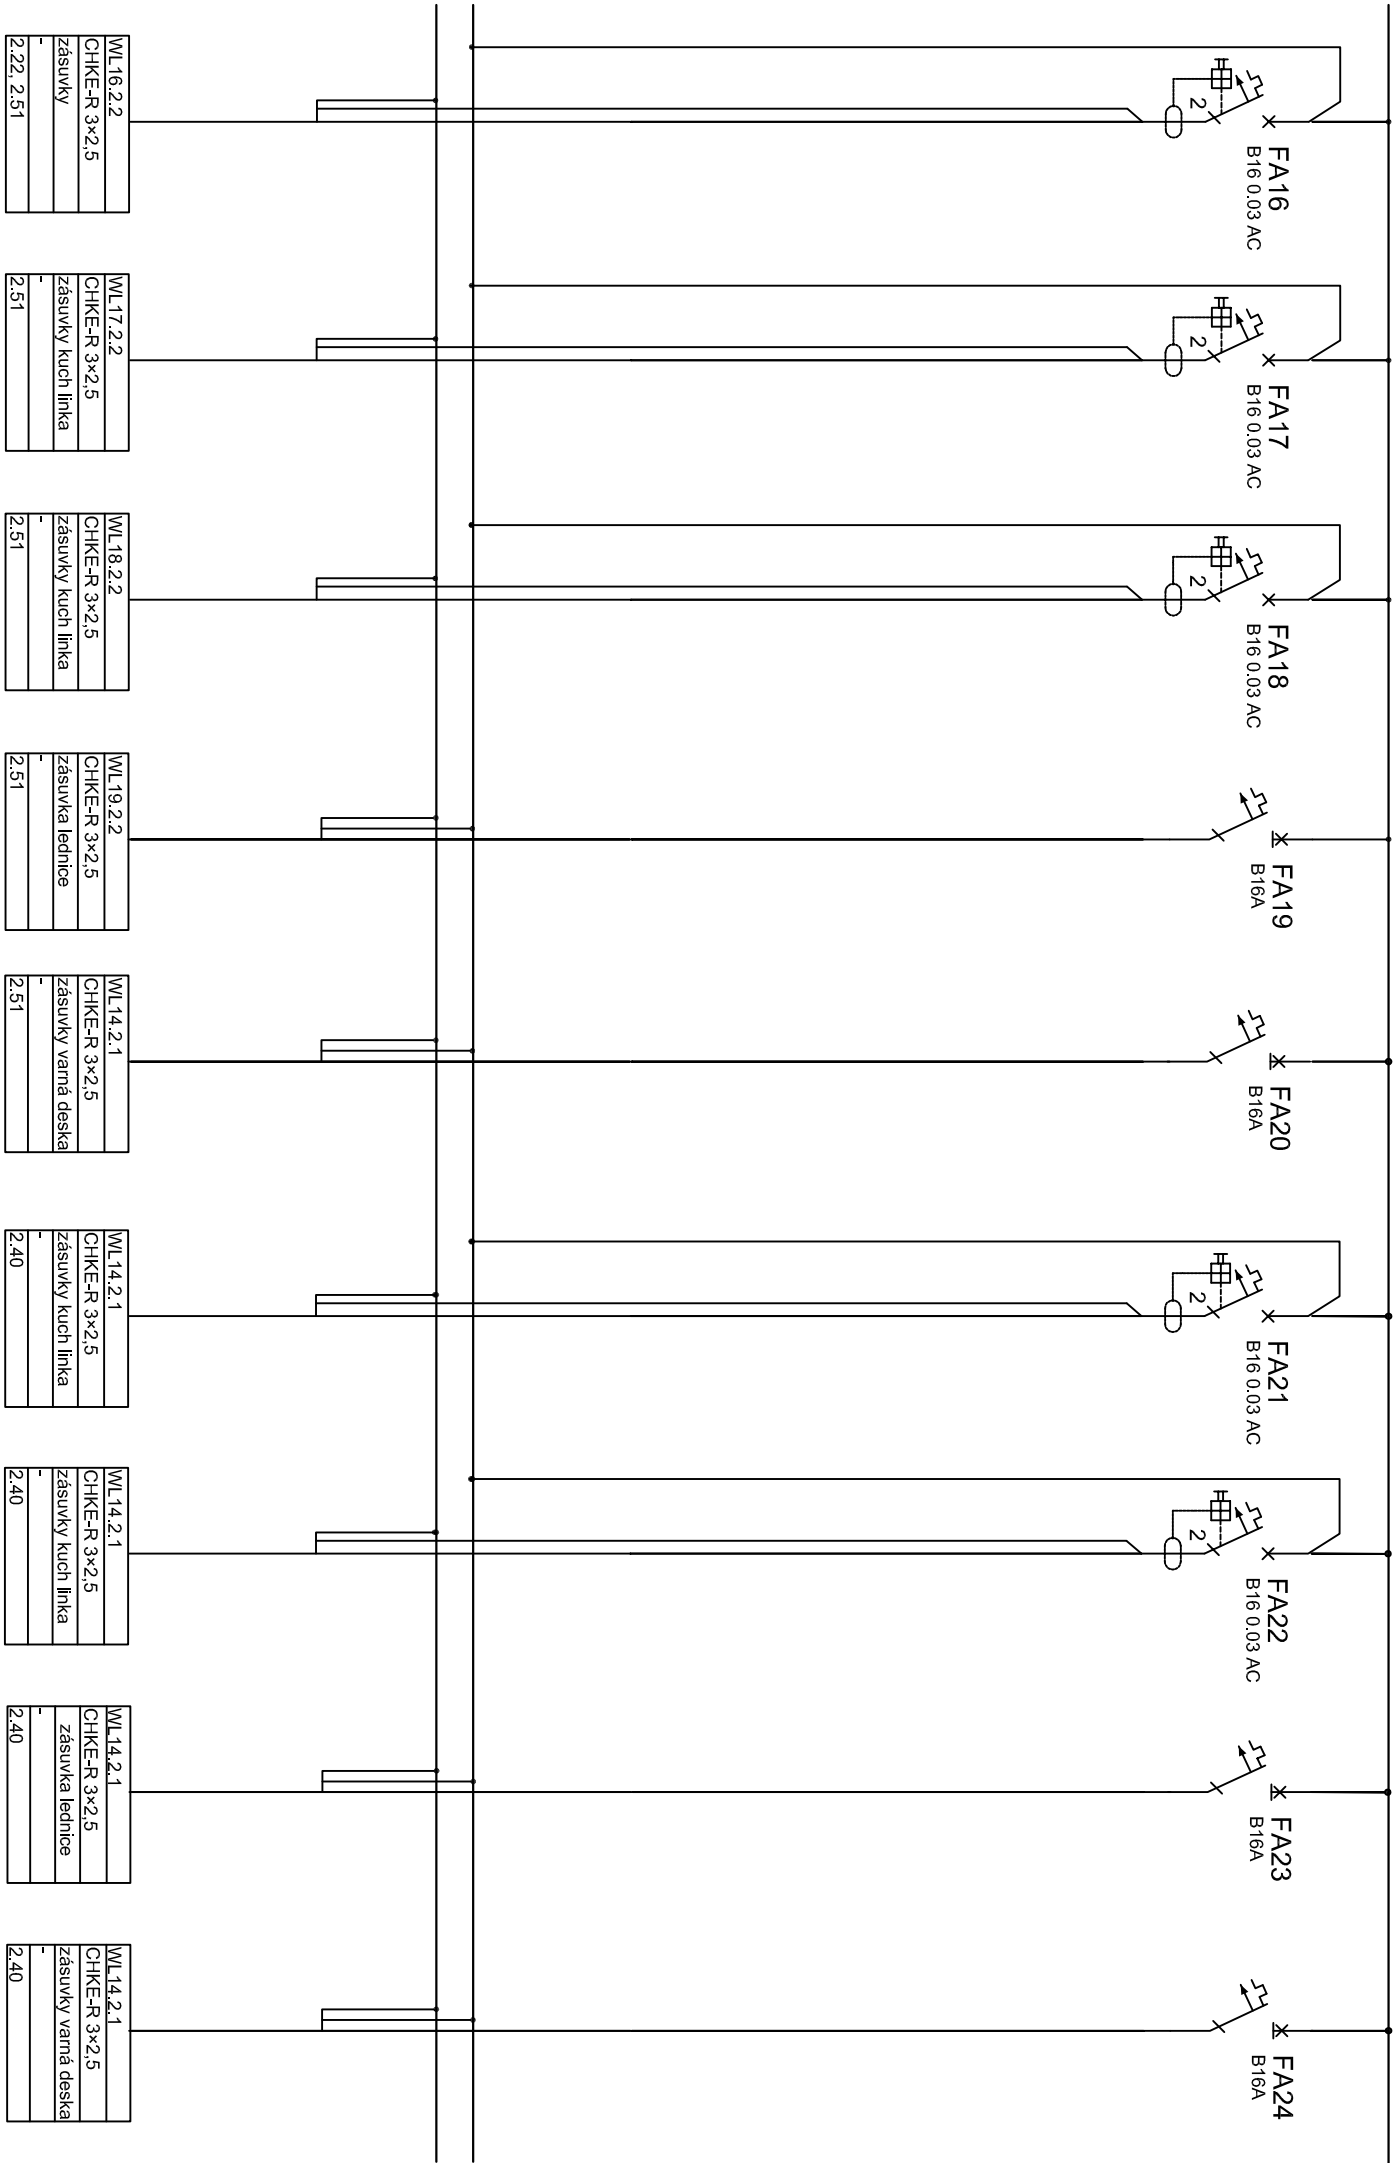

L1,L2,L3 - 400/230V In 40A 50Hz Ik < 10kA

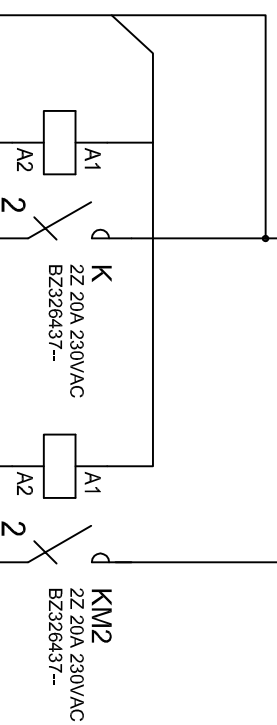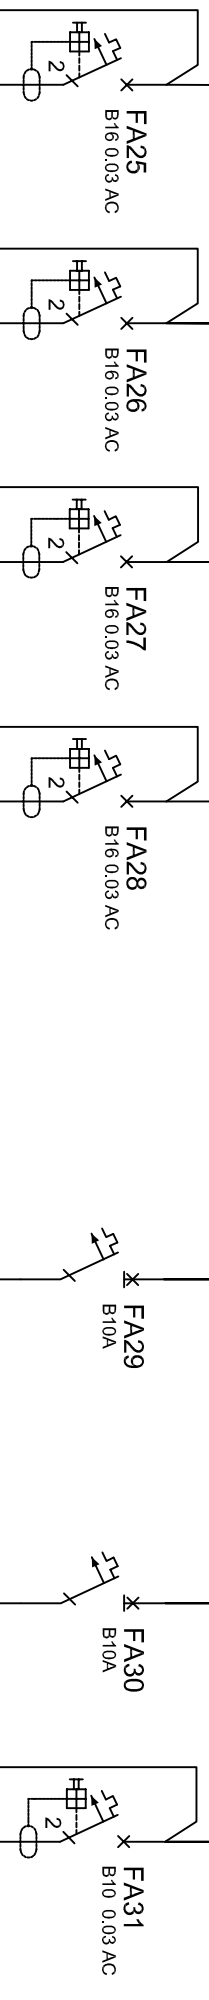

rezerva
-

rezerva
-

rezerva

rezerva
-


WL29.2.2a
CHKE-R 3x1,5
vypínače v recepcii
-

WL29.2.2
CHKE-R 3x1,5
světlo chodba
-
2.51.2.40.2.22

WL30.2.2
CHKE-R 3x1,5
světlo chodba
-
2 51 2 40 2 22

WL31.2.2
CHKE-R 3×1,5
světlo
-
2.31, 2.26, 2.23,24

L1,L2,L3 - 400/230V In 40A 50Hz Ik < 10kA

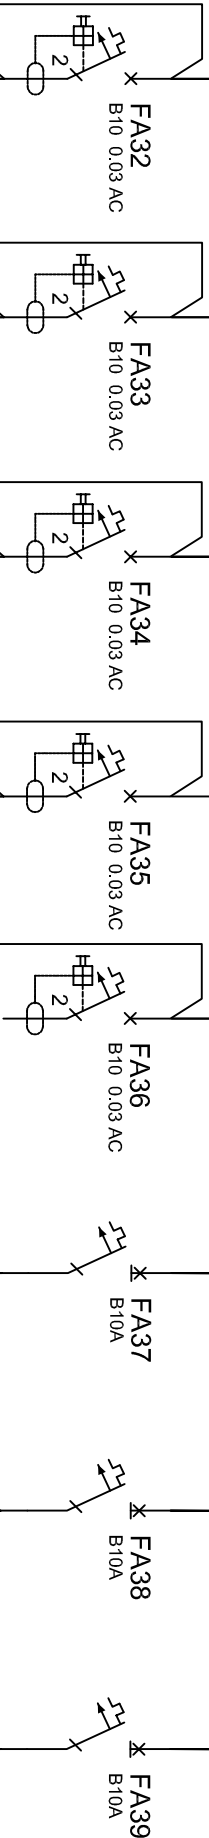

WL32.2.2
CHKE-R 3x1.5
světlo
-
2.33, 2.35

WL33.2.2
CHKE-R 3x1.5
světlo
-
2.37, 2.39

WL34.2.2
CHKE-R 3x1.5
světlo
-
2.46, 2.48, 2.50

WL35.2.2
CHKE-R 3x1.5
světlo
-
2.44, 2.42

rezerva
-

WL37.2.2
CHKE-R 3x1.5
žaluzie
0.8 kW
-

WL38.2.2
CHKE-R 3x1.5
žaluzie
0.8 kW
-

WL29.2.1
CHKE-R 3x1.5
nouzové světlo
0.8 kW
-

rezerva
-