


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----

12/05/2015










Obsah: **R0.1**  
Akce: Domov pro seniory Havlíčkův Brod

D.1.4.7. SILNOPROUDÁ ELEKTROTECHNIKA  
VČETNĚ OCHRANY PŘED BLESKEM

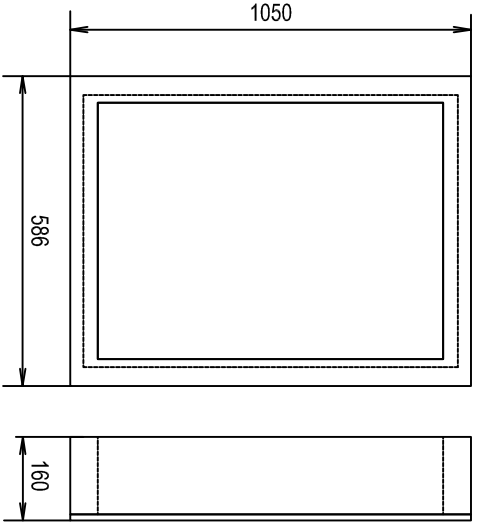

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
Vypracoval: Marek Fischer										Investor: Domov pro seniory Havlíčkův Brod				Zak.číslo: TO-472		A.K.:		Listů: 3	
Kontroloval: Ing. Martin Uličný												Změna/Datum:				V.č.:		List: 1	
Datum : 10/2016												Měřitko: N				D.1.4.7.b.11.			

L1,L2,L3 - 400/230V In 63A 50Hz, Ik <10kA

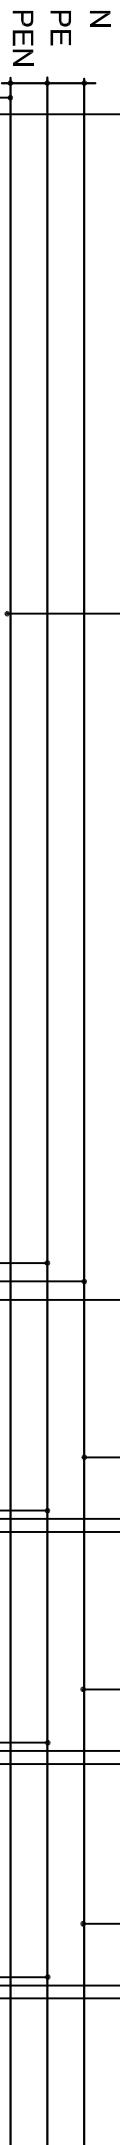

WL1
CHKE-R 4x10 +25
Přívod
45 kW
Rozvodna přádelna

rezerva
-

rezerva
-


WL3.01
CHKE-R 3x2,5
VZT8
0,5kW
01.03

WL4.01
CHKE-R 3x2,5
zásuvky
01.01

WL5.01
CHKE-R 3x2,5
zásuvky
01.01

WL6.01
CHKE-R 3x2,5
zásuvky
01.17, 18, 03, 04

L1,L2,L3 - 400/230V In 63A 50Hz, Ik <10kA

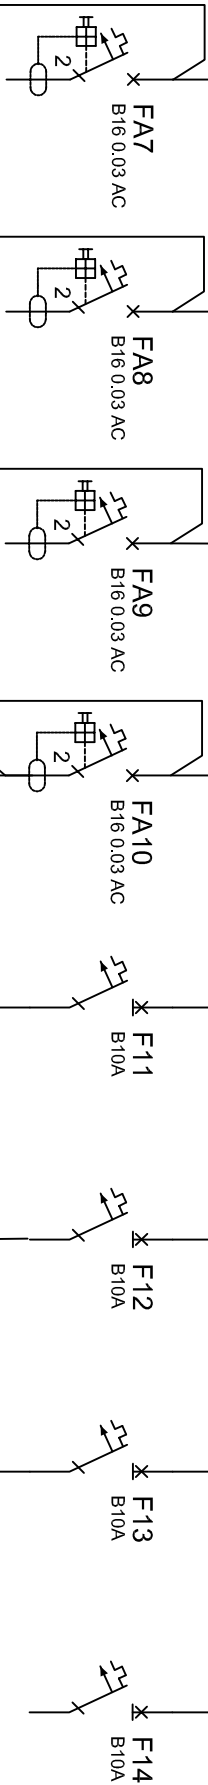

WL 12.01a
CHKE-R 3×1,5
OVL. TLAČITKA
-
1.106

rezerva
-

rezerva
-

rezerva
-

WL 10.01
CHKE-R 3×1,5
světlo
0,4 kW
01.01

WL 11.01
CHKE-R 3×1,5
světlo
1 kW
01.17, 03, 04

WL12.01
CHKE-R 3×1,5
světlo schodiště
0,6 kW
01.19

WL 13
CYKY-J 3×1,5
nouzové světlo
0,5 kW
01.18.01 02, 03, 04, 17

rezerva
-