


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----


Obsah: **R1.1**

Akce: Domov pro seniory Havlíčkův Brod



D.1.4.7. SILNOPROUDÁ ELEKTROTECHNIKA
VČETNĚ OCHRANY PŘED BLESKEM

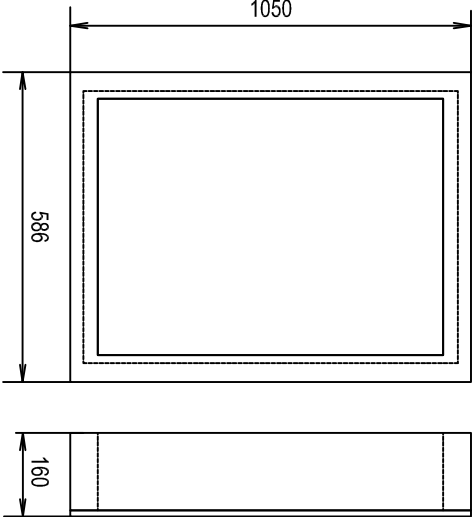

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
Vypracoval:	Marek Fischer									Investor:				Zak. číslo:	TO-472	A.K.:		Listů:	5
Kontroloval:	Ing. Martin Ulčňý									Domov pro seniory Havlíčkův Brod				Změna/Datum:		V.č.:		List:	
Datum :	10/2016													Měřtko:	N		D.1.4.7.b.12.		1

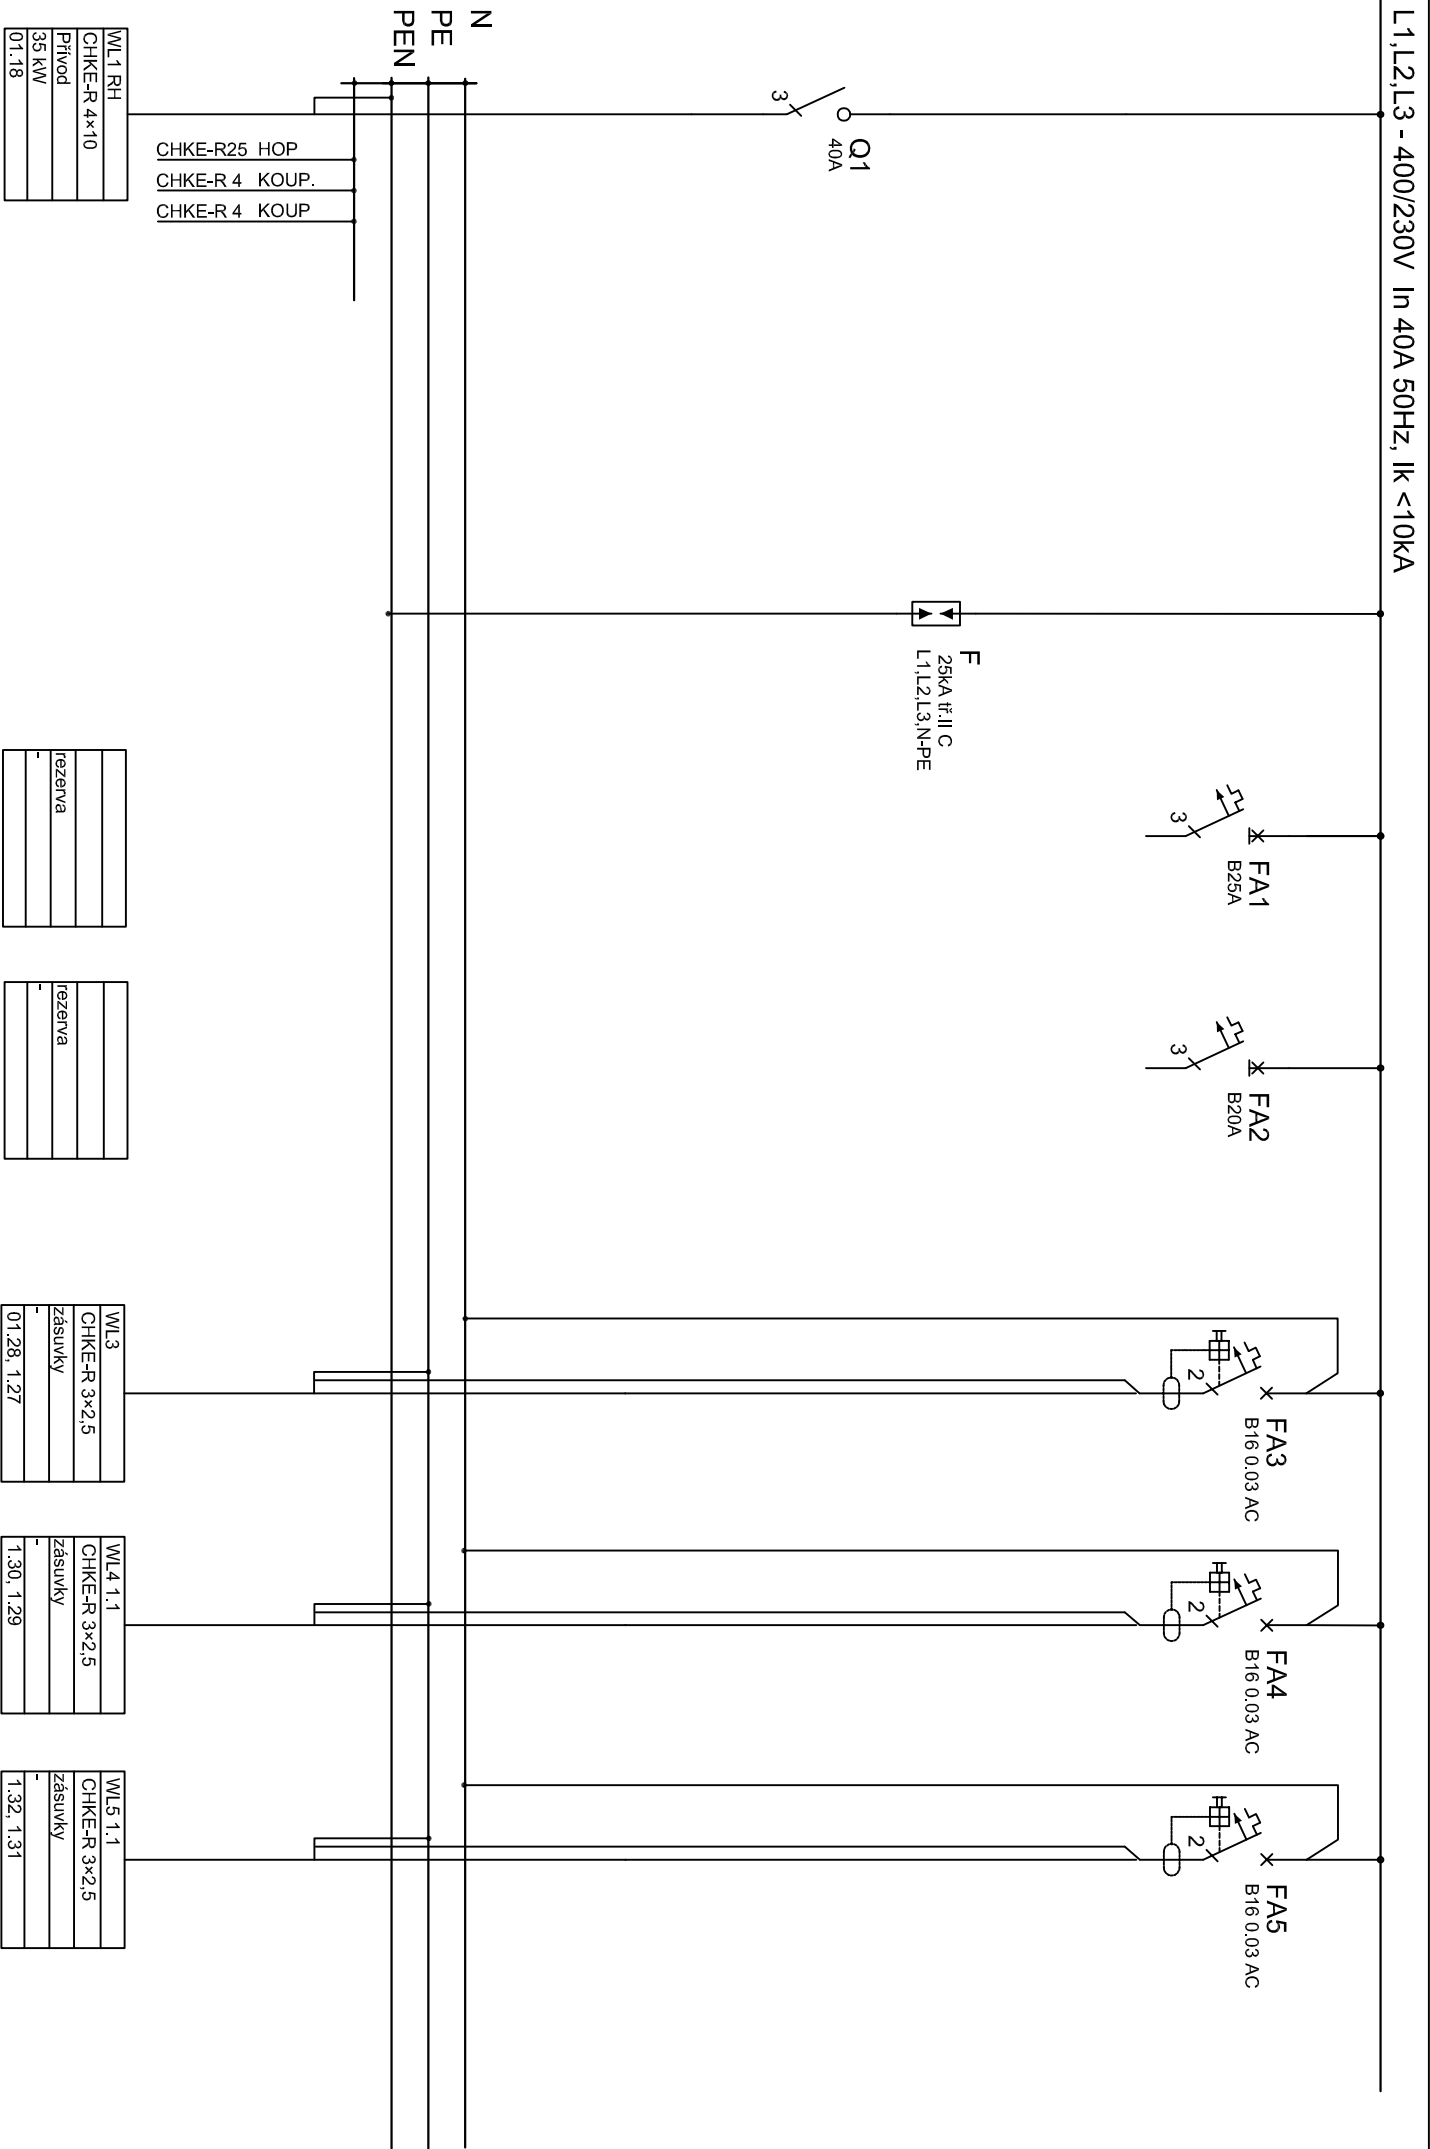

L1,L2,L3 - 400/230V In 40A 50Hz, Ik <10kA

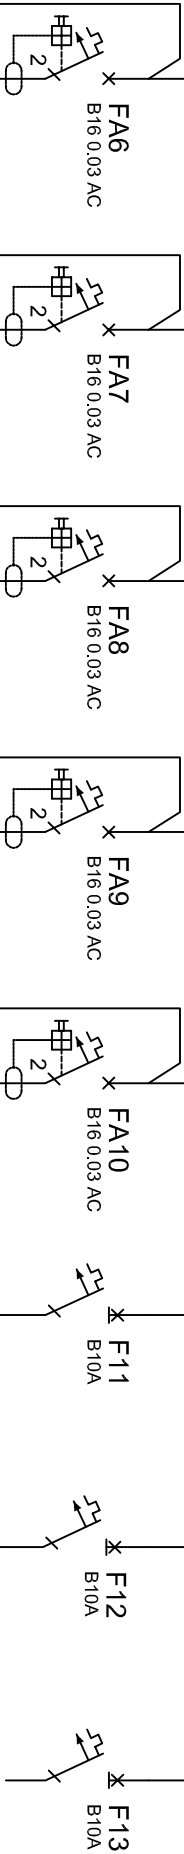

WL6 1.1
CHKE-R 3x2,5
zásuvky
-
1.34, 1.33

WL7 1.1
CHKE-R 3x2,5
zásuvky
-
1.36, 1.35

WL8 1.1
CHKE-R 3x2,5
zásuvky
-
1.38, 1.37

WL9 1.1
CHKE-R 3x2,5
zásuvky
-
1.40, 1.39


WL10 1.1
CHKE-R 3x2,5
zásuvky
-
1.43, 1.47, 1.44, 1.46

WL 11 1.1
CHKE-R 3x1,5
exteriové žaluzie
0,5 kW

WL 12 1.1
CHKE-R 3x1,5
exteriové žaluzie
0,5 kW

rezerva

L1,L2,L3 - 400/230V In 40A 50Hz, Ik <10kA

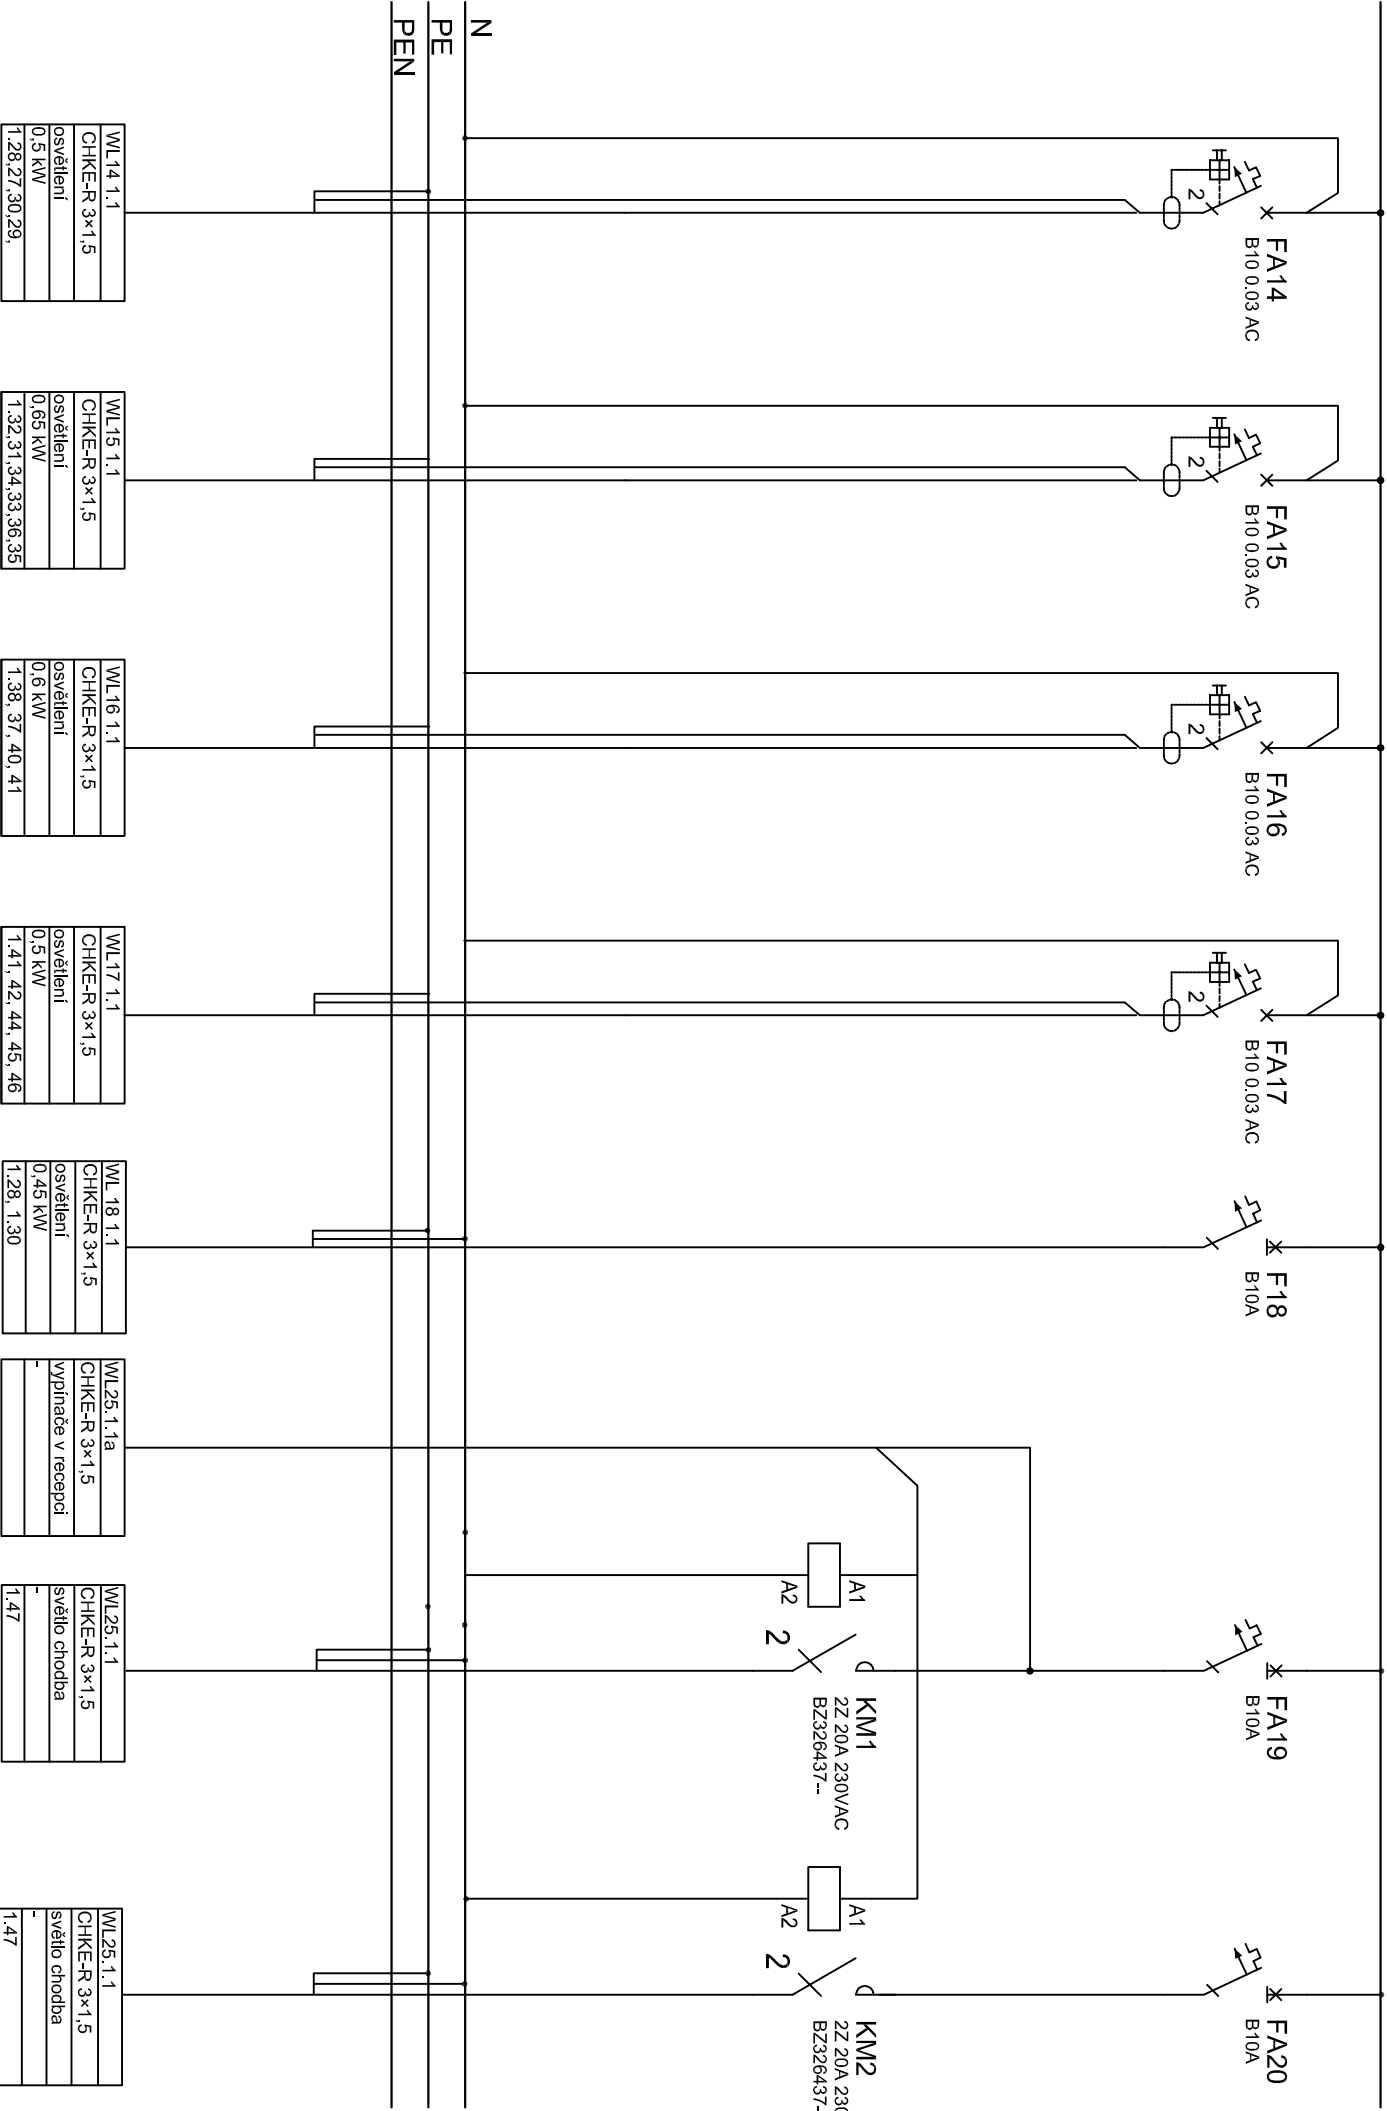

L1,L2,L3 - 400/230V In 40A 50Hz, Ik <10kA

