


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----

Obsah: **R3.2**

Akce: Domov pro seniory Havlíčkův Brod

D.1.4.7. SILNOPROUDÁ ELEKTROTECHNIKA
VČETNĚ OCHRANY PŘED BLESKEM

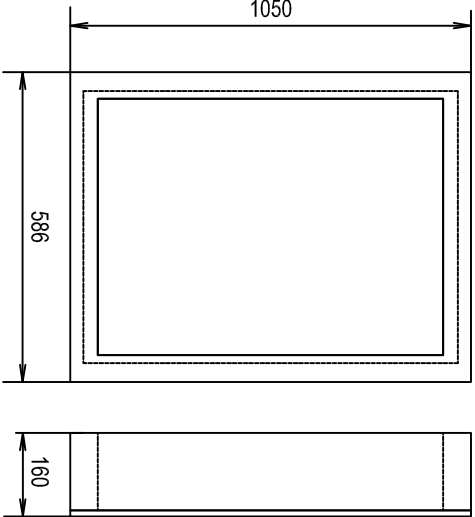

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
Vypracoval:	Marek Fischer									Investor:				Zak. číslo:	TO-472	A.K.:		Listů:	5
Kontroloval:	Ing. Martin Uličný									Domov pro seniory Havlíčkův Brod				Změna/Datum:		V.č.:		List:	
Datum :	10/2016													Měřtko:	N		D.1.4.7.b.19.		1

L1,L2,L3 - 400/230V In 40A 50Hz, Ik <10kA

Q1
40A

F
50kA tř II C
L1,L2,L3,N+PE

F1
B25A

F2
B20A

FA3
B16 0.03 AC

FA4
B16 0.03 AC

FA5
B16 0.03 AC

FA6
B16 0.03 AC

CHKE-R25 HOP
CHKE-R 4 KOUP.
CHKE-R 4 KOUP

WL7
CHKE-R
RH
35kV
-

rezerva

rezerva

WL3.3.2
CHKE-R 3x2.5
zásuvky
-
3.31

WL4.3.2
CHKE-R 3x2.5
zásuvky
-
3.33

WL5.3.2
CHKE-R 3x2.5
zásuvky
-
3.35

WL6.3.2
CHKE-R 3x2.5
zásuvky
-
3.37


N

PE


PEN

OP


L1,L2,L3 - 400/230V In 40A 50Hz Ik < 10kA

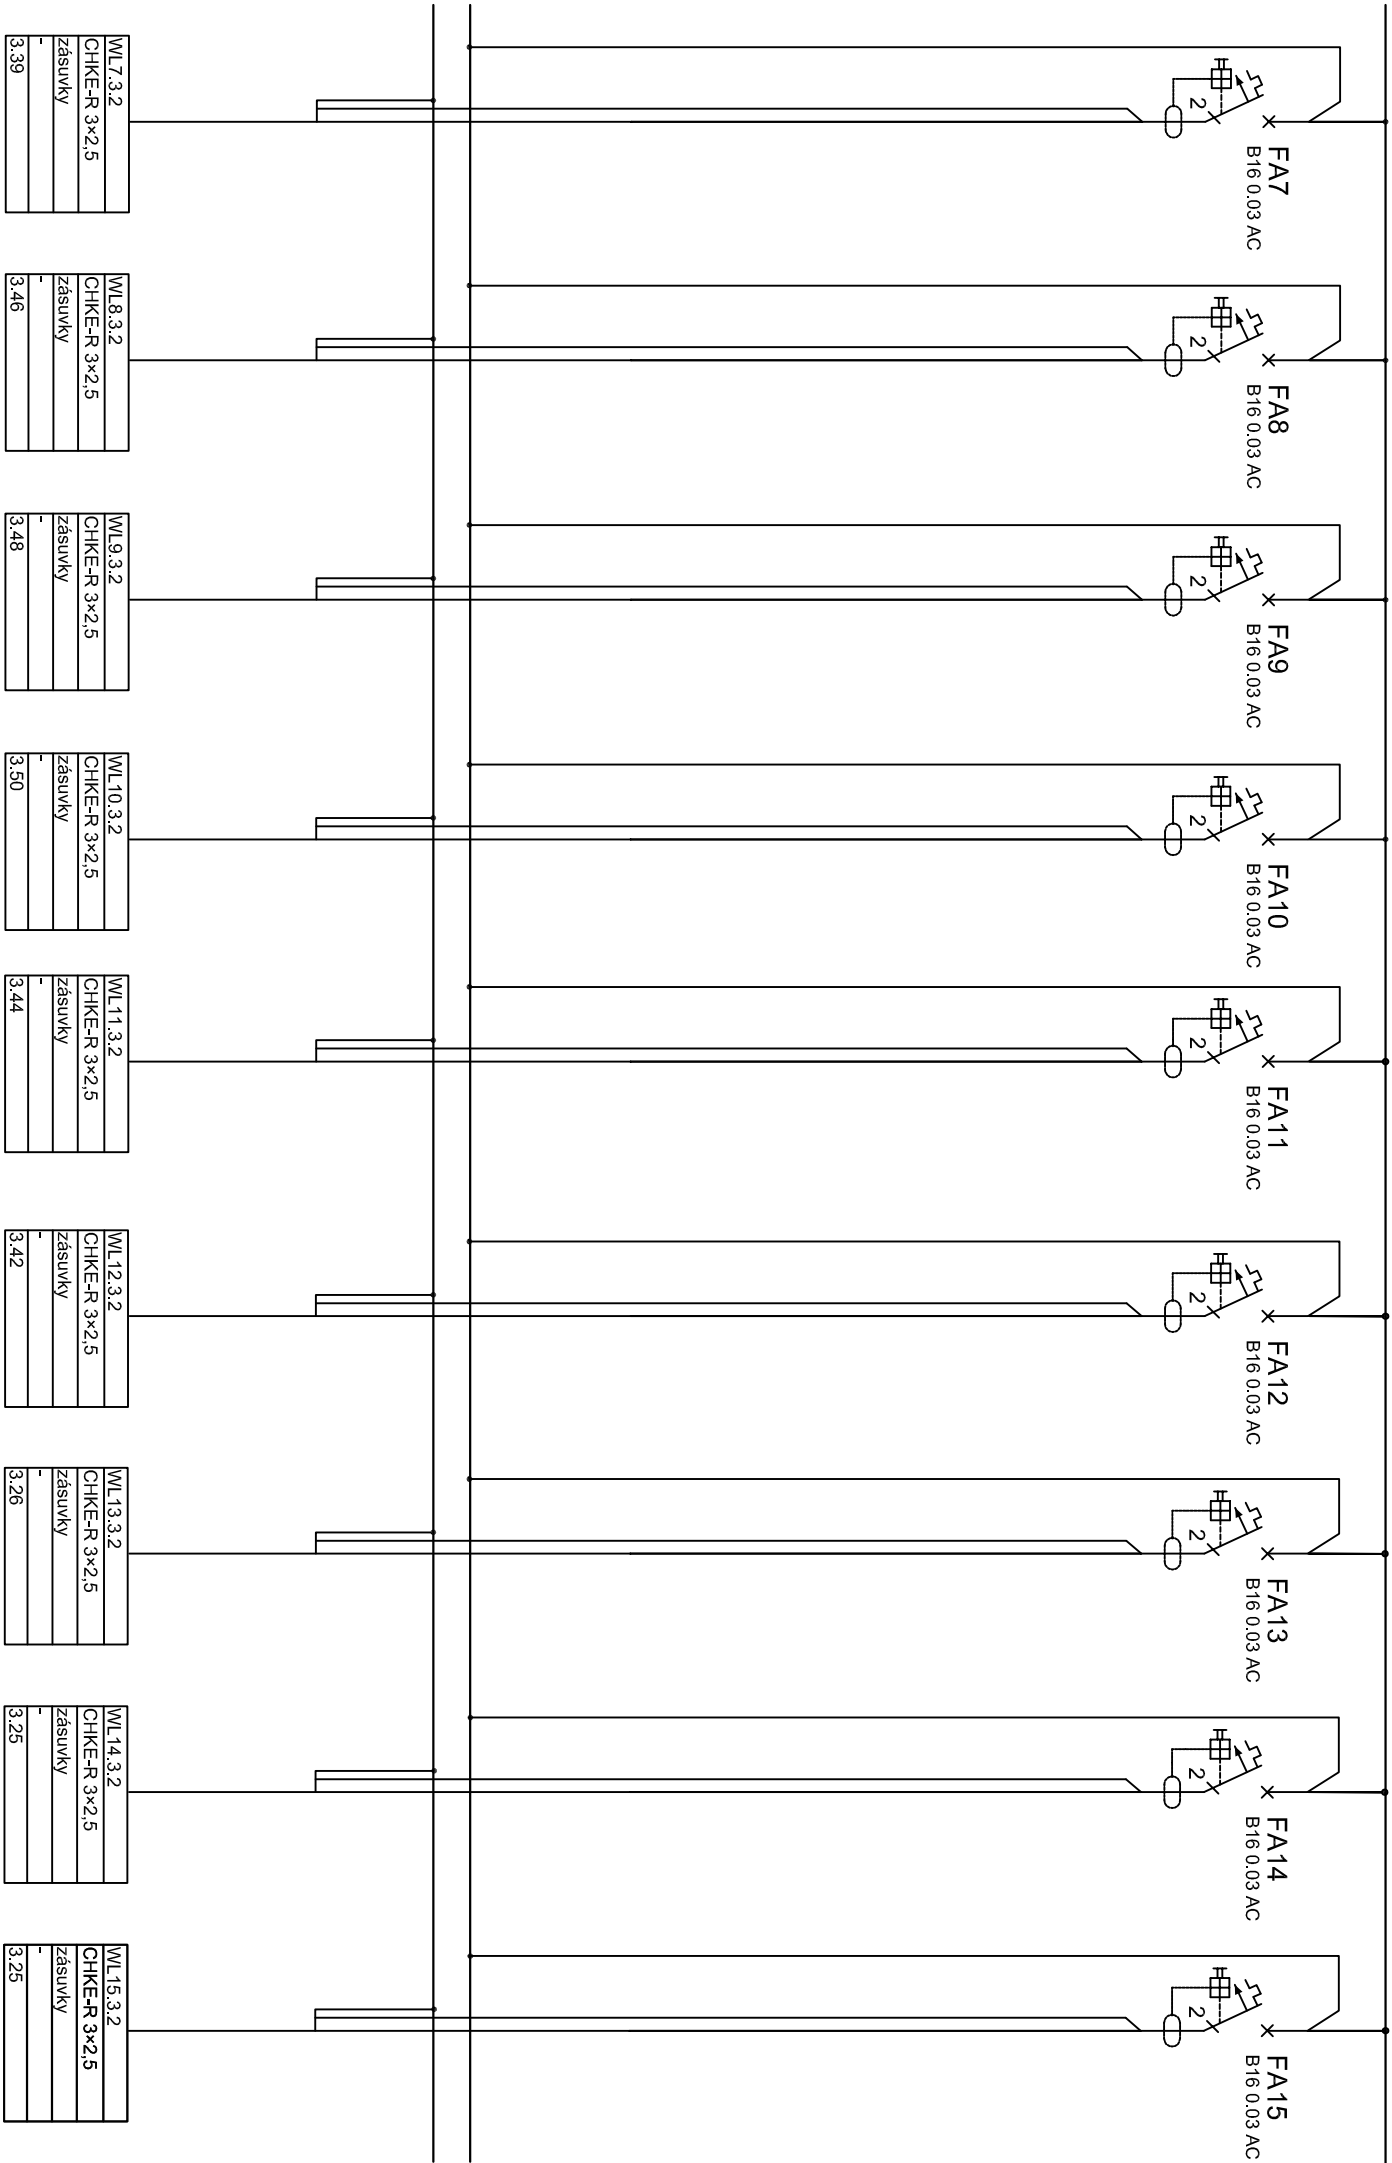

L1,L2,L3 - 400/230V In 40A 50Hz Ik < 10kA

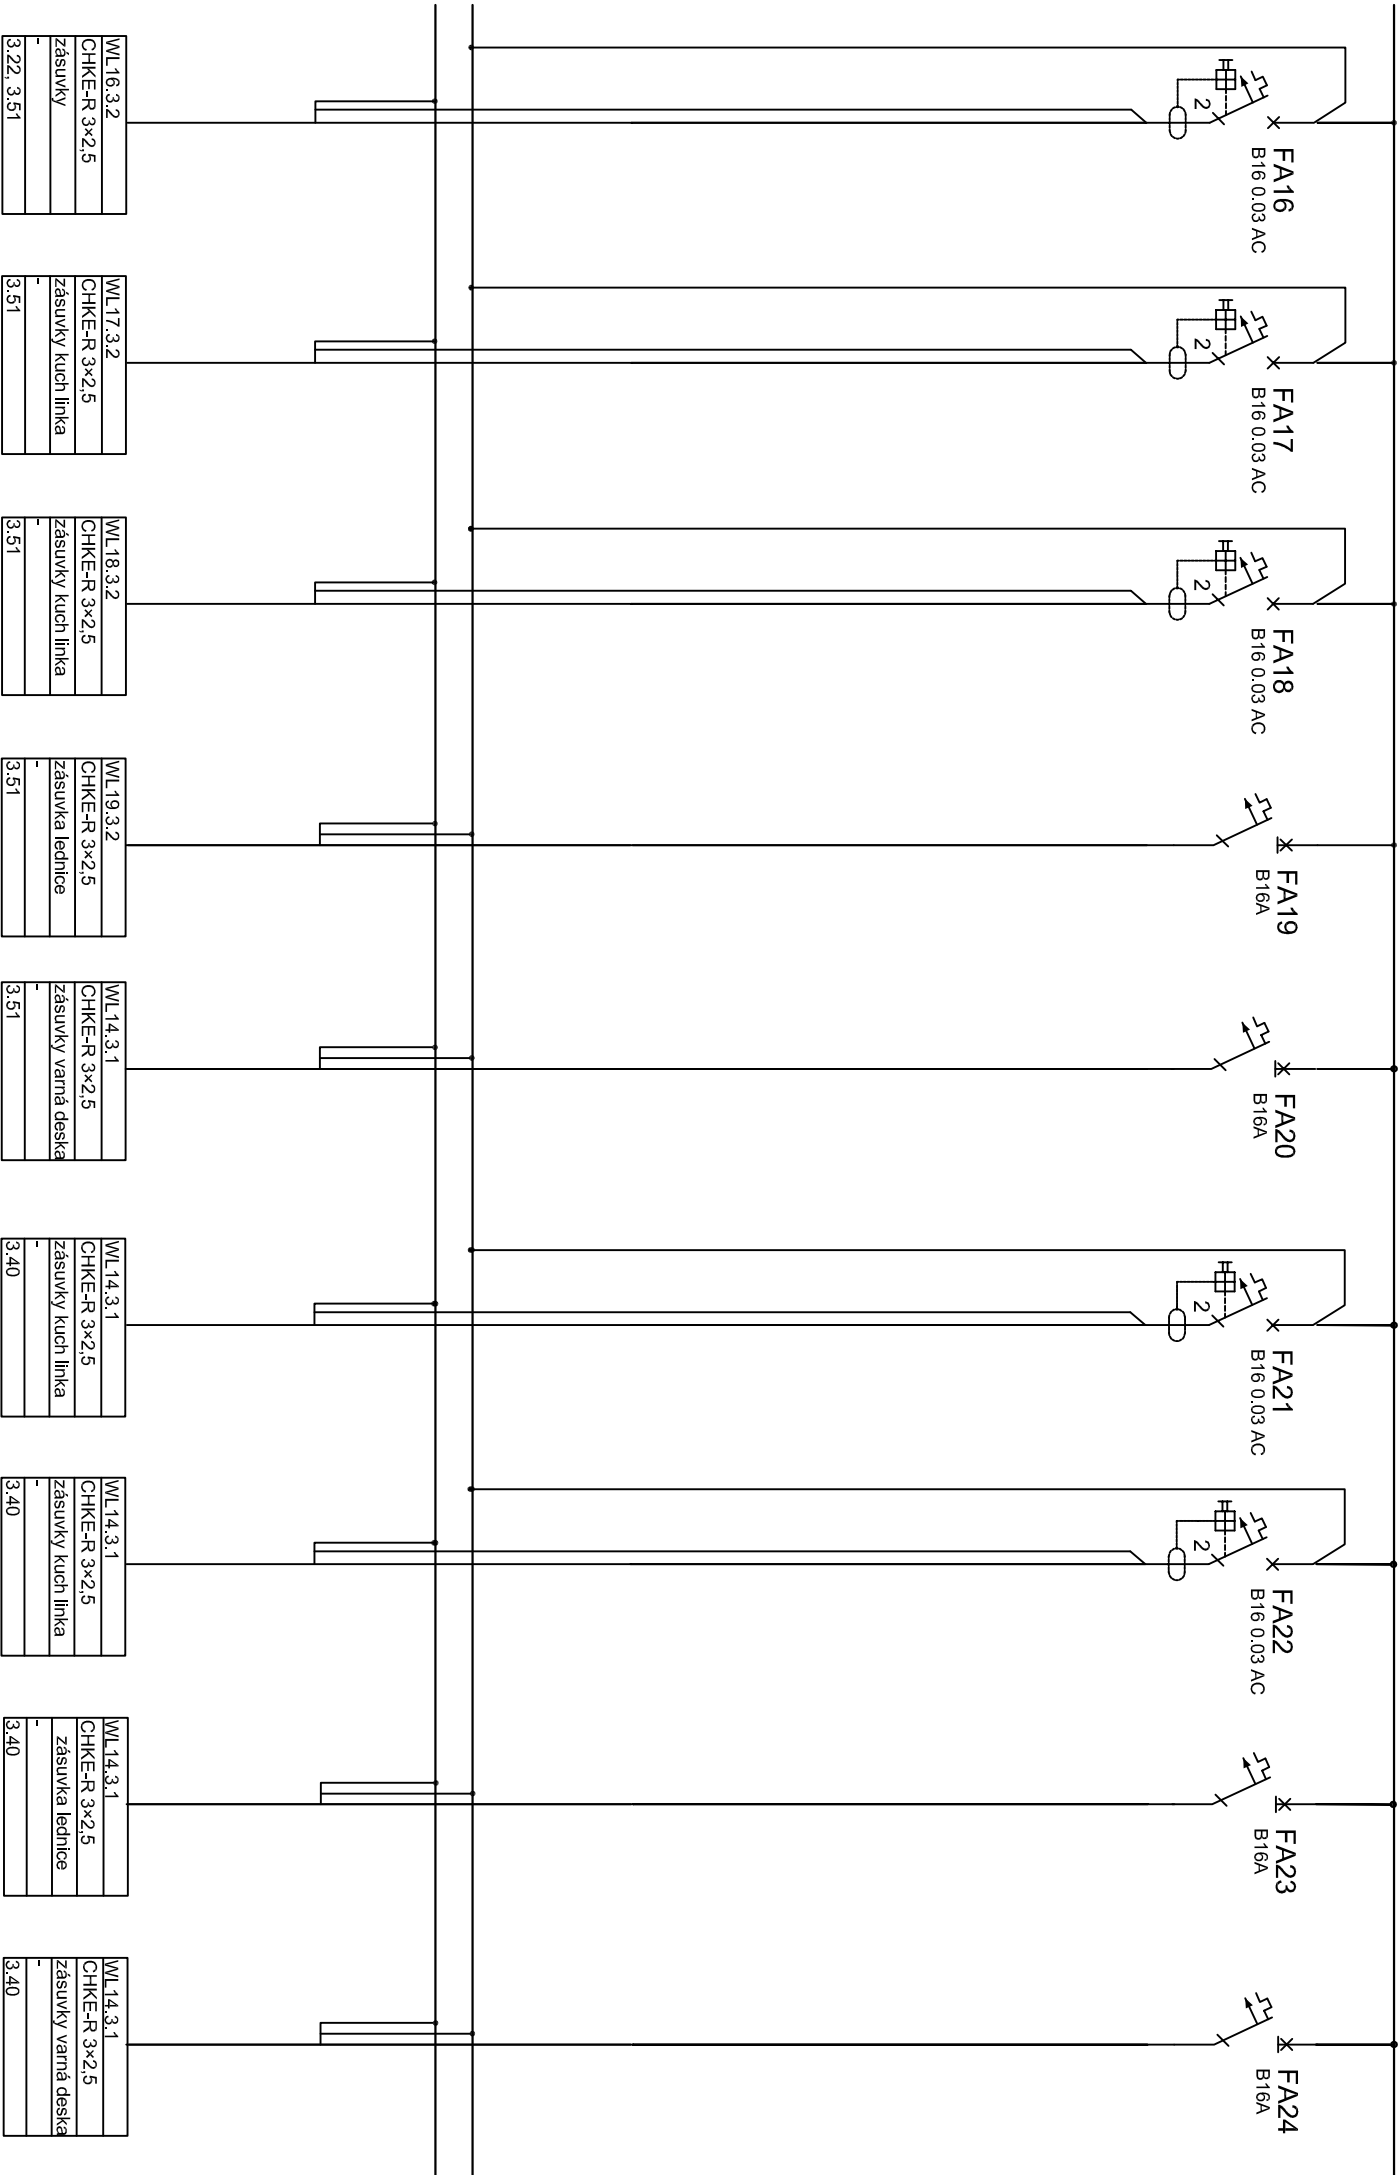

L1,L2,L3 - 400/230V In 40A 50Hz Ik < 10kA

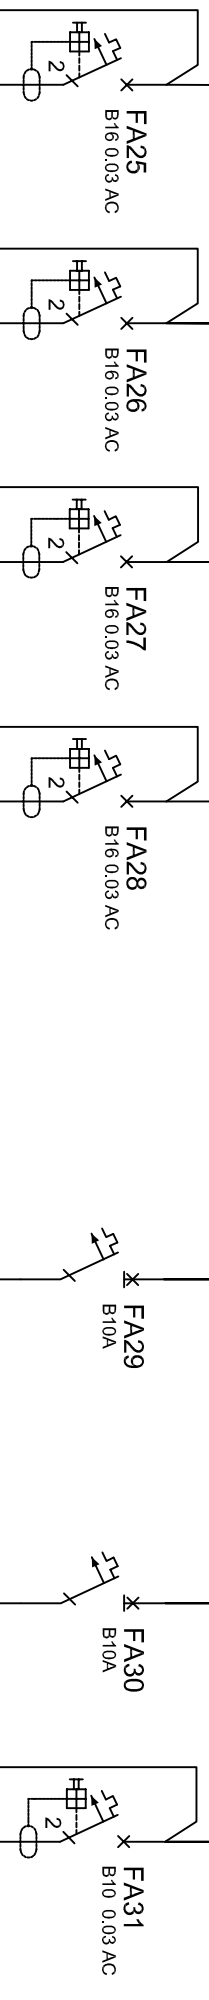

rezerva
-

rezerva
-

rezerva

rezerva
-

WL29.3.2a
CHKE-R 3x1,5
vyplínače v recepcii
-

WL29.3.2
CHKE-R 3x1,5
světlo chodba
-
3.51, 3.40, 3.22

WL30.3.2	
CHKE-R 3x1,5	
světlo chodba	
-	
3.51 3.40 3.22	

WL31.3.2
CHKE-R 3×1,5
světlo
-
3.31, 3.26, 3.23,24

L1,L2,L3 - 400/230V In 40A 50Hz Ik < 10kA

