


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----

12/05/2015


Obsah: **RZ**
Akce: Domov pro seniory Havlíčkův Brod

D.1.4.7. SILNOPROUDÁ ELEKTROTECHNIKA
VČETNĚ OCHRANY PŘED BLESKEM


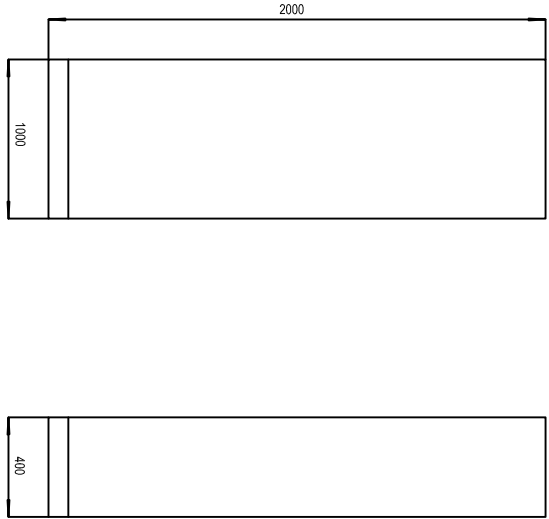


1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20
Vypracoval:	Marek Fischer									Investor:				Zak. číslo:	TO-472	A.K.:		Listů:	3
Kontroloval:	Ing. Martin Ulčňý									Domov pro seniory Havlíčkův Brod				Změna/Datum:	-	V.č.:		List:	
Datum :	10/2016													Měřtko:	N		D.1.4.7.b.10.		1

L1,L2,L3 - 400/230V In 63A 50Hz, Ik <10kA

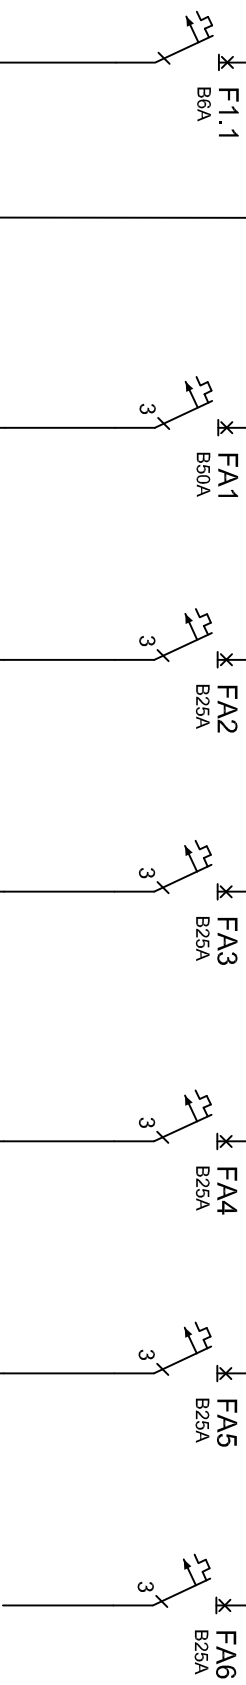

F
50kA tř. II C
L1,L2,L3,N-PE

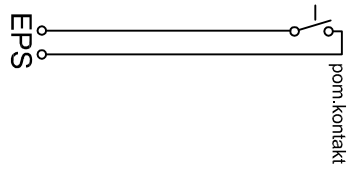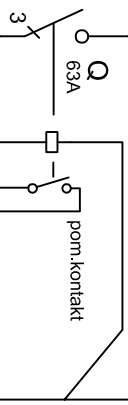

N

PE

PEN

WL1
AVKY 3x120+95
Přívod
45 kW
Rozvodna přádelna

WL0.5
CHKE-V- 3x1.5
TOTAL STOP

WL1Z
CHKE-R 4x16
požární UPS
35kW
01.17

WL2Z
CHKE-R 5x6
RZ1
17kW
1.02c


WL3Z
CHKE-R 5x6
RZ2
17kW
2.22

WL4Z
CHKE-R 5x6
RZ3
17kW
3.22

WL5Z
CHKE-R 5x6
RZ4
17kW
4.26

rezerva

L1,L2,L3 - 400/230V In 63A 50Hz, Ik <10kA

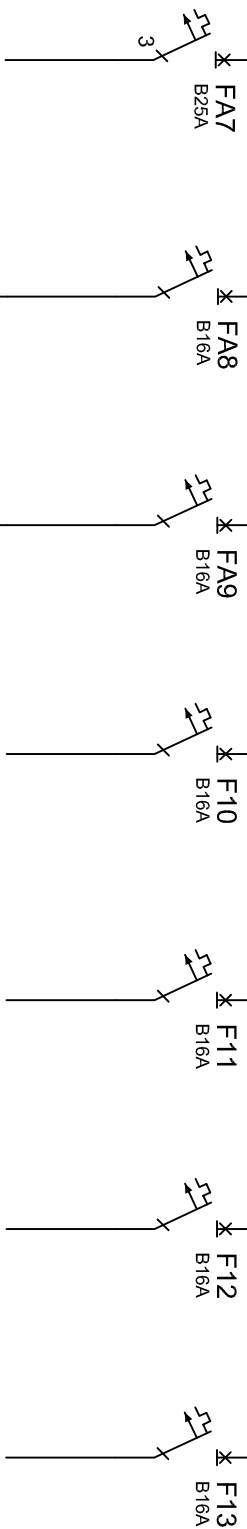

N						
PE						
PEN						

	WL1Z	WL2Z			
	CHKE-R 3×2,5	CHKE-R 5×6 + 1×25			
	UPS server	RZ1			
rezerva	2 kW	17kW	rezerva	rezerva	rezerva
	01.10a	1.02c			